

01  
SHT -

## TYPICAL FENCE ELEVATION

1:20 @ A3

### NOTES:

#### NETTING INFILL:


- SHALL BE GALVANISED 50mm×2.5mm CHAIN LINK MESH OR EQUIVALENT. JOINS IN MESH SHALL BE MADE BY UNCLENCHING THE END LINK AND SPIRALING IN A JOINING LINK TO FORM A SEAMLESS JOIN.

#### STEELWORK:

- ALL PIPE AND FITTINGS SHALL BE HOT DIPPED GALVANISED. CUT ENDS OF PIPE SHALL BE COATED WITH INORGANIC ZINC BEFORE ASSEMBLY. ALL PIPE SHALL BE GRADE 250 MED PE PIPE TO BS 1387-1985, SIZES AS SHOWN ON THE DRAWING.
- NO HOLES ARE TO BE DRILLED IN PIPE SECTIONS. WIRE IS TO BE TIED TO EACH POST (NOT THROUGH DRILLED HOLES).

#### CONCRETE:

- POST FOUNDATIONS ARE TO BE FROM CONCRETE HAVING A MINIMUM 20MPa STRENGTH AFTER 28 DAYS. THE CONCRETE SHALL HAVE A MAXIMUM AGGREGATE SIZE OF 20mm.

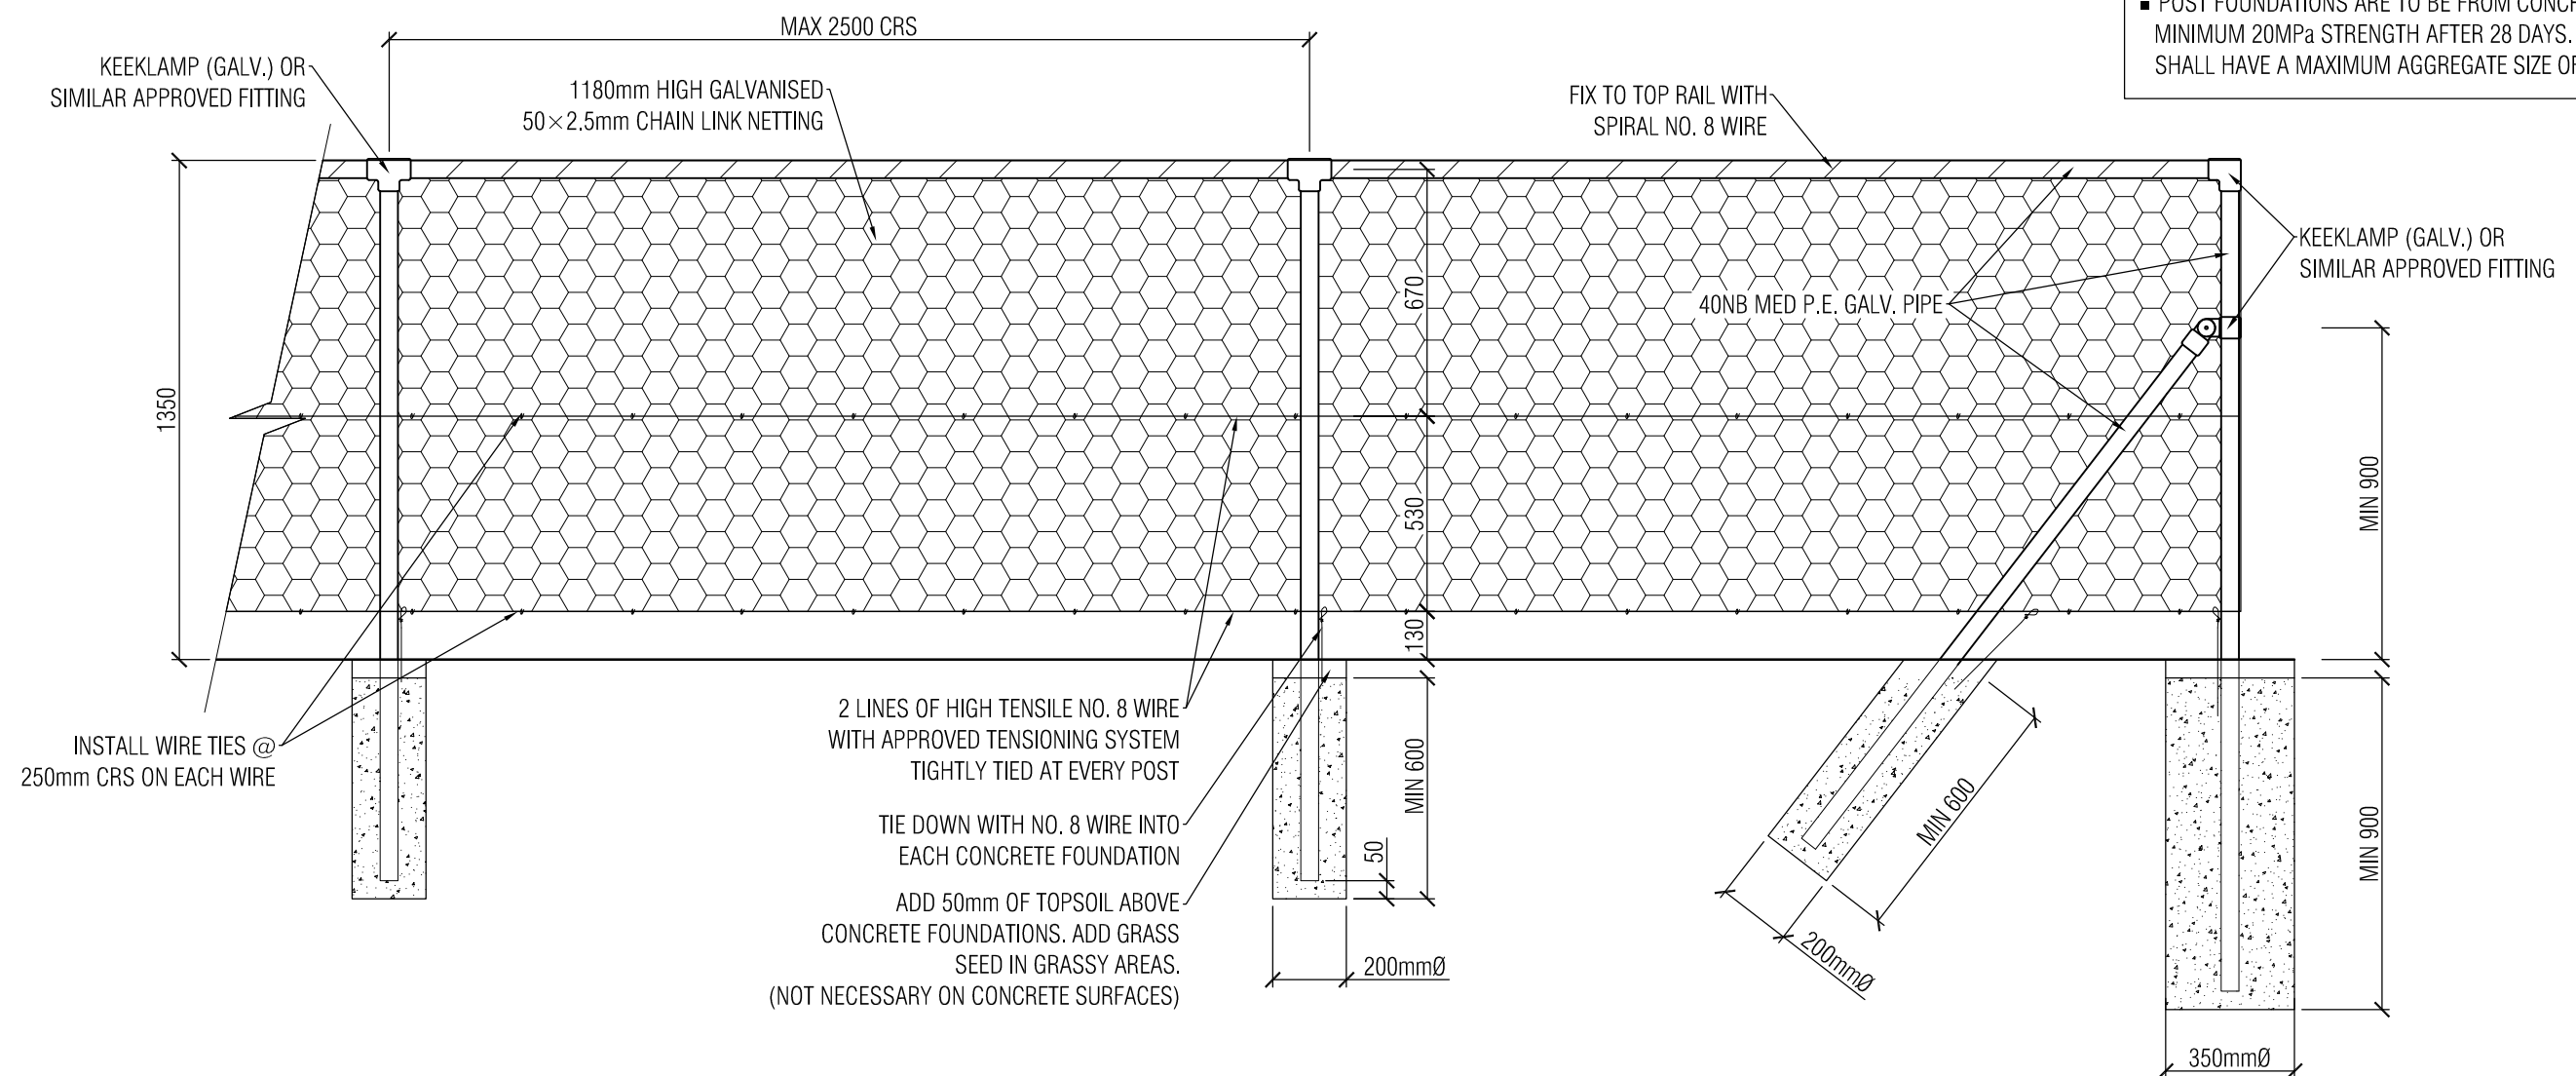

### FENCE CORNER AND END POST WITH BRACE

INSTALL 2 PARALLEL TO FENCE CORNERS